

POMPOWNIE ŚCIEKÓW Pp 1

2a

$$Q = 10.80 \text{ l/s} = 38.90 \text{ m}^3/\text{h}$$


$$Q_{\text{doc}} = 15.84 \text{ l/s} = 57.03 \text{ m}^3/\text{h}$$

$$H = 8.4 \text{ m} + 6.04 = 14.44 \text{ m}$$

$$\phi 2000 \times 7.780 \text{ mm}$$

TQRH/101-1-230

4 kW 1450 obr/min

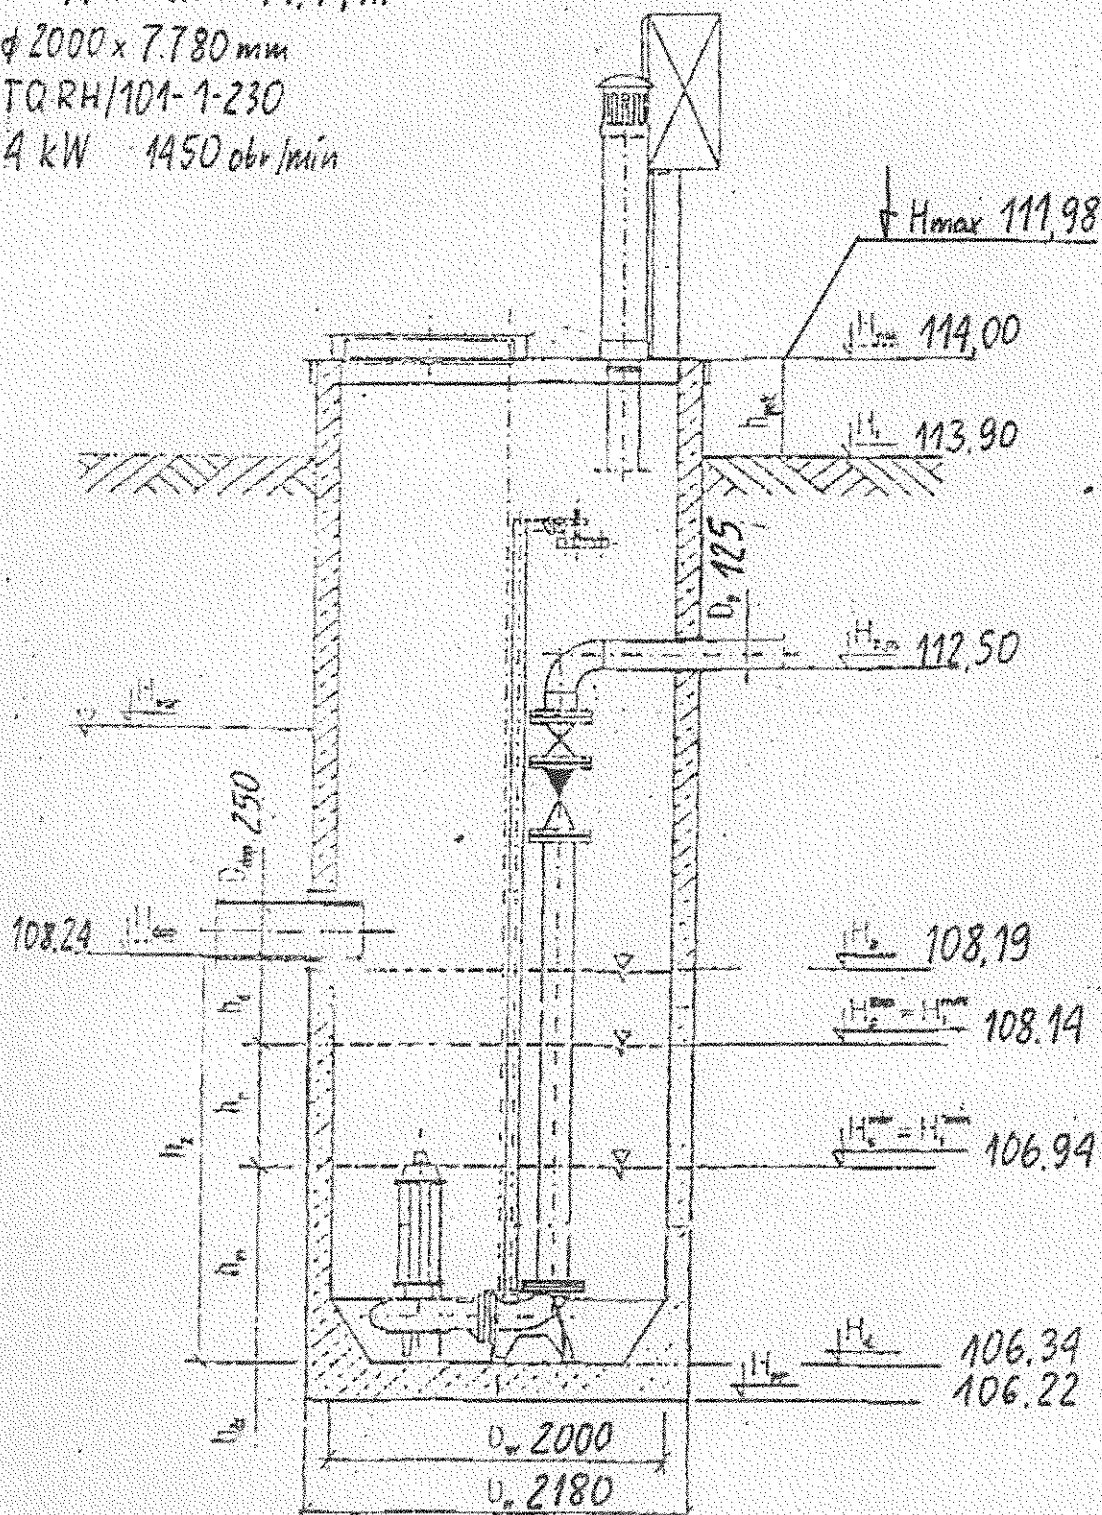

P.T.H.U. HYDRO-MARKO

63-200 Jarocin

ul. Wojska Polskiego 139

tel. 0-62 7471-809, fax 0-62 7475-865

NIP 617-000-72-62, Regon: 280784827