

2d

POMPOWNIÉ ŚCIEKÓW Pk 1


$$Q = 13.25 \text{ l/s} = 47.7 \text{ m}^3/\text{h} \quad Q_{\text{aoc}} = 18.50 \text{ l/s} = 66.6 \text{ m}^3/\text{h}$$

$$H = 0.4 + 7.82 = 8.22 \text{ m}$$

$$\phi: 2000 \times 7590 \text{ mm}$$

TQRH/81-1-210

3 kW 1450 obr/min

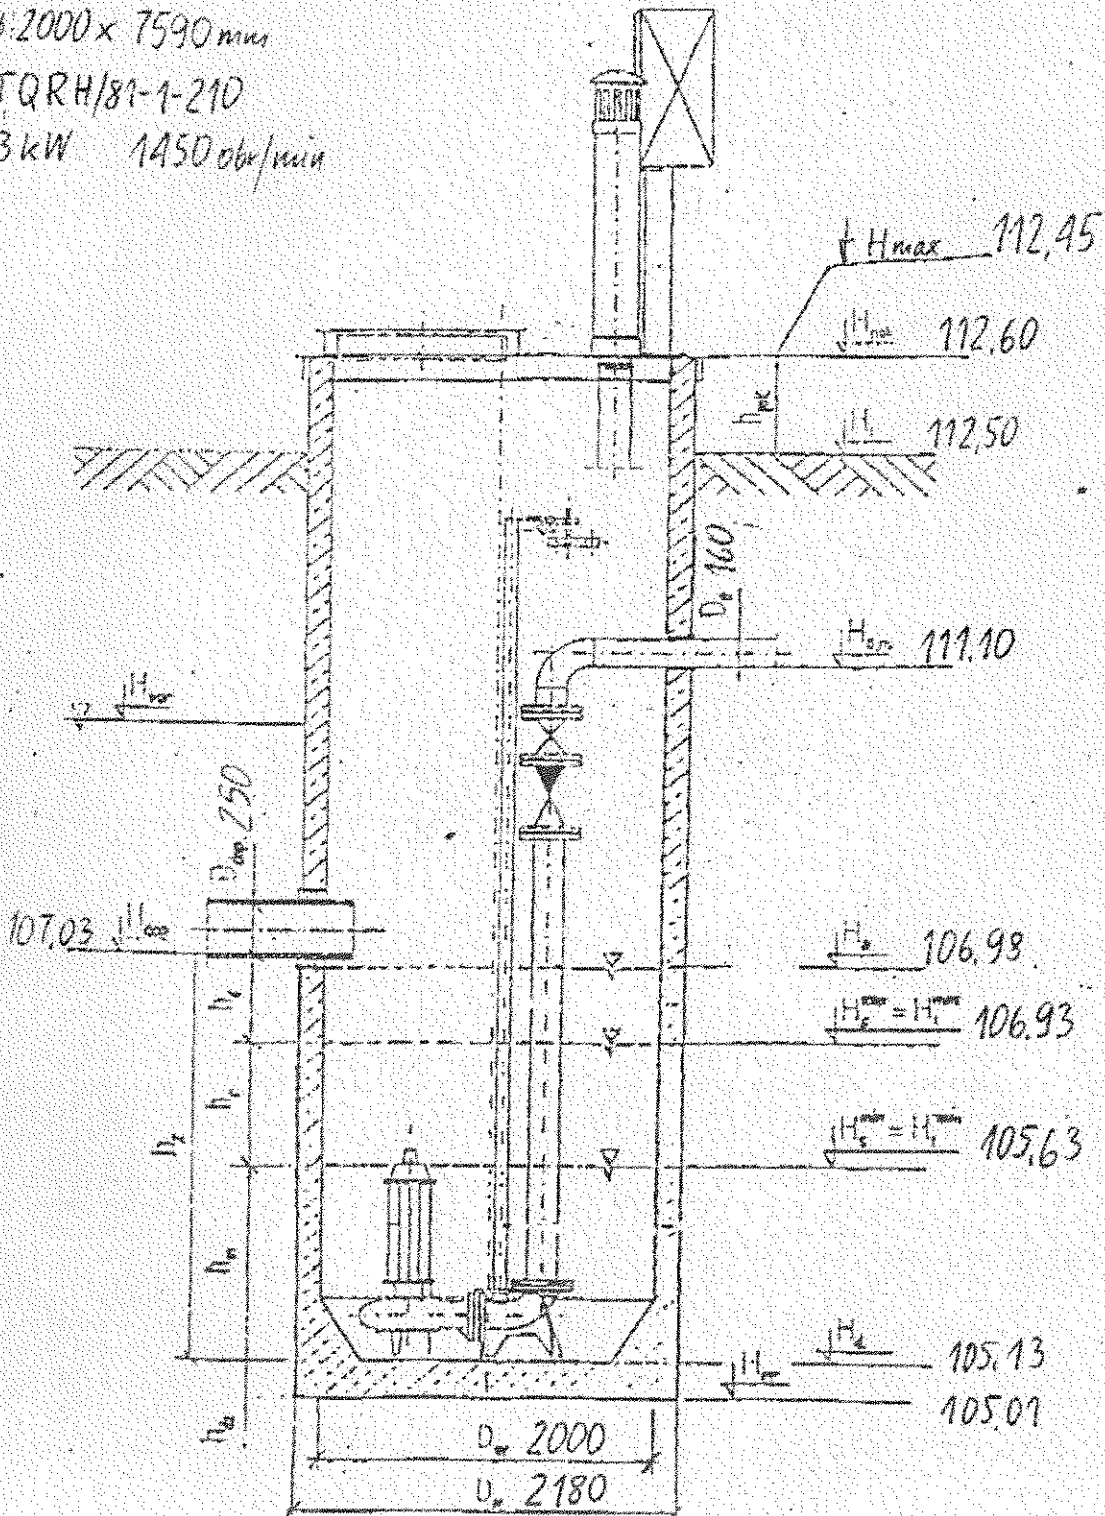

P.T.H.U. HYDRO-MAR

63-200 Jarocin

ul. Wojska Polskiego 139

tel. 0-62 7471-609, fax 0-62 7475-885

NIP 617.000.70.02, REGON 140670465